



REVISIONS				
SYM	DESCRIPTION	BY	APP	DATE
-	RELEASE	LS	MY	4/10/00

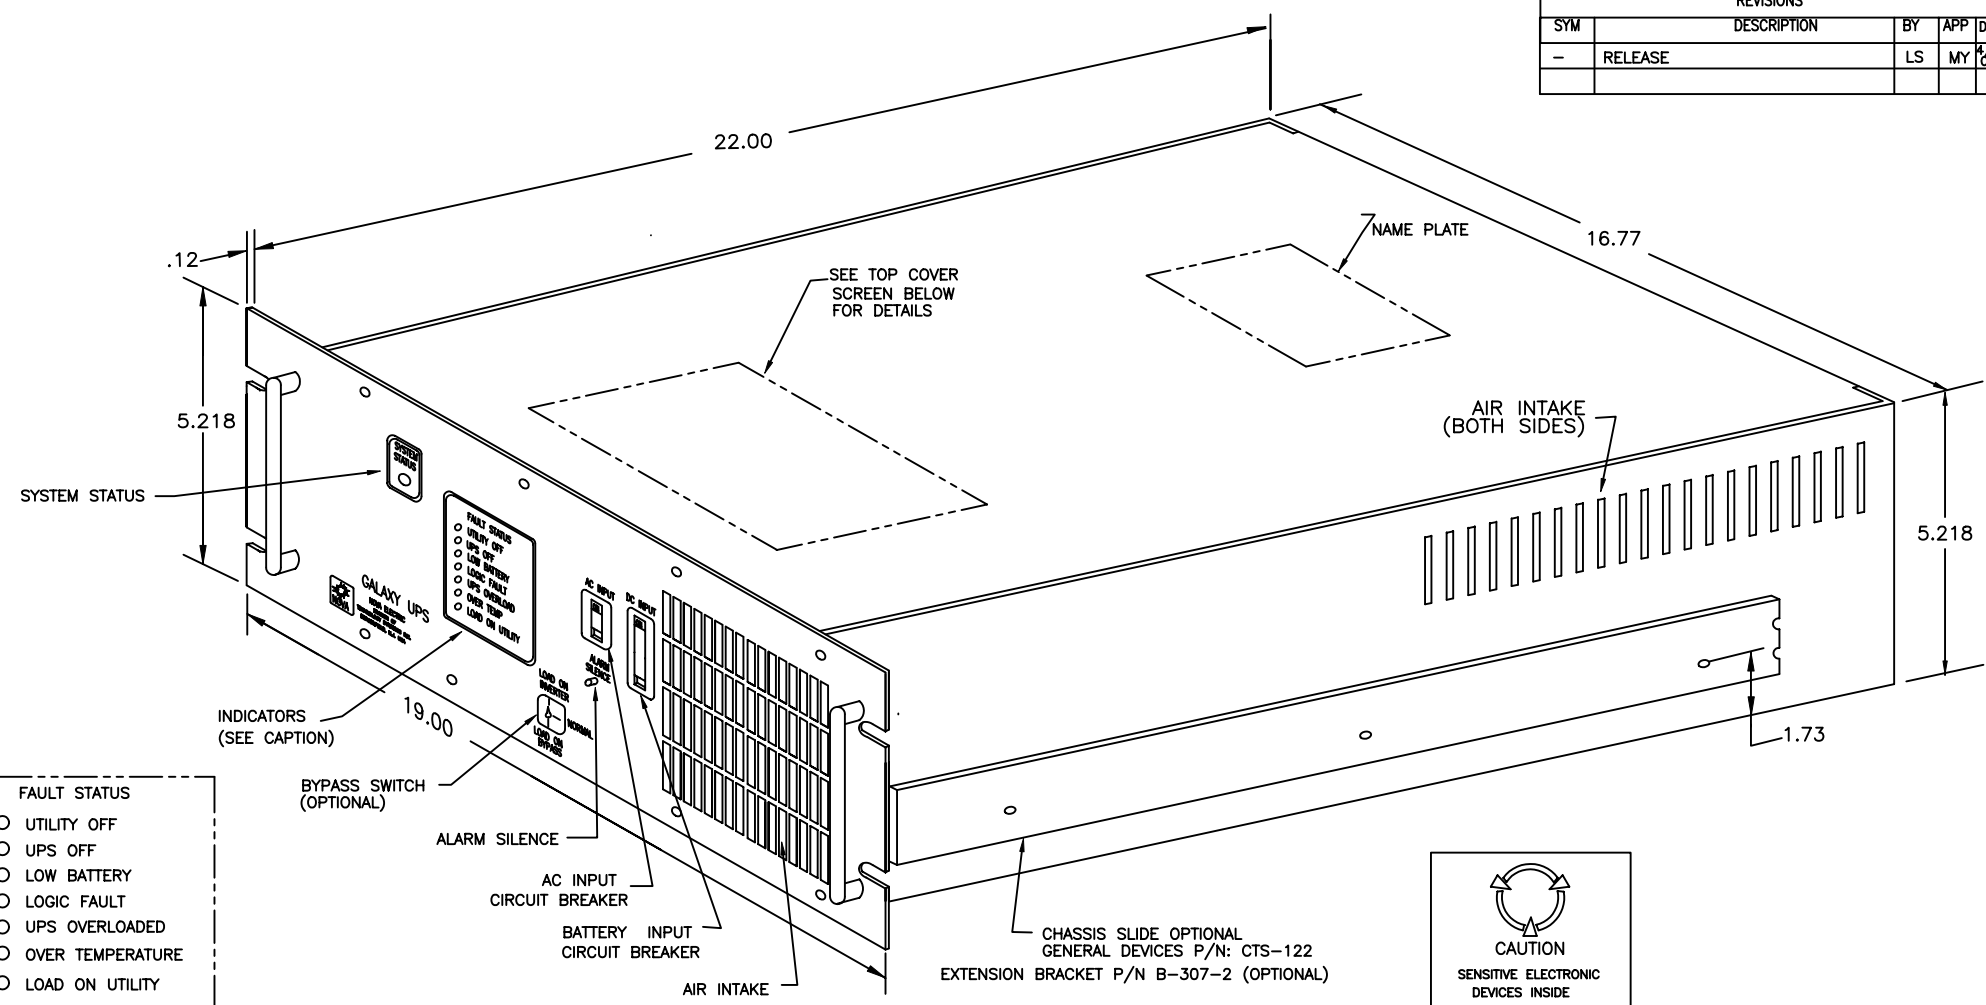


- FAULT STATUS**
- UTILITY OFF
 - UPS OFF
 - LOW BATTERY
 - LOGIC FAULT
 - UPS OVERLOADED
 - OVER TEMPERATURE
 - LOAD ON UTILITY



WARNING: FOR CONTINUED PROTECTION AGAINST RISK OF FIRE, REPLACE FUSES WITH SAME TYPE & RATING.
 WARNING: NO USER SERVICEABLE PARTS INSIDE, REFER SERVICING TO QUALIFIED PERSONNEL ONLY.
 WARNING: USE ONLY BATTERY POWERED OR UNGROUNDED TEST EQUIPMENT WHEN SERVICING THIS EQUIPMENT.
 CAUTION: INTENDED FOR USE IN A PROTECTED ENVIRONMENT.

TOP COVER SCREEN

- NOTES:**
1. ALL DIMENSIONS ARE IN INCHES.
 2. EXTERIOR ANSII# 61 GRAY SEMI-GLOSS
 3. HANDLES PROJECT 1.50 INCHES FROM PANEL SURFACE.

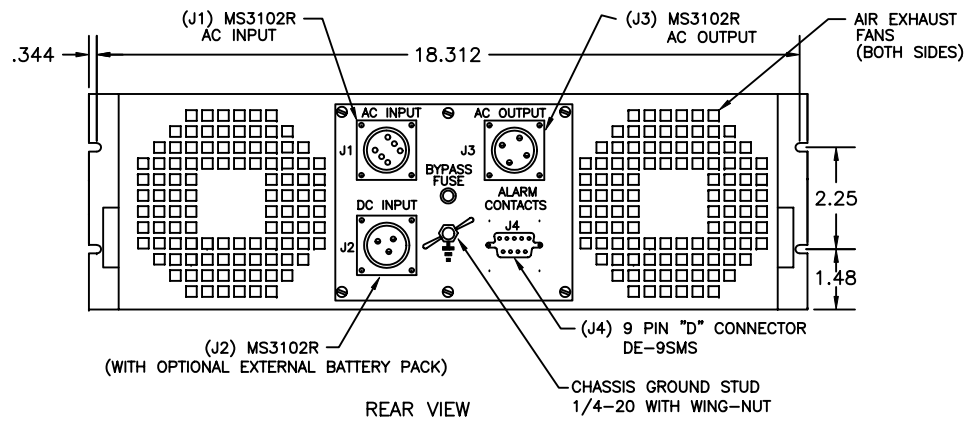

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES. TOLERANCES: FRAC. DEC. ANGLES +/-1/64XX=+/-02 +/-2 XXX=+/-005DEG		THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND MAY NOT BE REPRODUCED WITHOUT THE PERMISSION OF NOVA ELECTRIC.		NOVA ELECTRIC A DIV. OF TECHNOLOGY DYNAMICS INC. 100 SCHOOL STREET BERGENFIELD, N.J. 07621-2915	
MATERIAL: N/A	FINISH: N/A	DRAWN BY: LS	DATE: 4/10/00	TITLE: OUTLINE DRAWING GRSL1KVA-2KVA UPS	
		CHECKED BY: MY	DATE: 4/10/00	SIZE: C	REV.:
		APPROVED BY: MY	DATE: 4/10/00	890781	-
		SCALE: NTS		CAGE: 29019	SHEET 1 OF 1